MASTER WASTEWATER REPORT FOR DEVELOPMENT UNIT 3 SOUTH AT EASTMARK

December 17, 2013 WP# 113697.08 REVIEWED BY
CITY STAFF
BY
DATE

NO CONNECTS



Submitted to:

City of Mesa

55 North Center Street

P.O. Box 1466

Mesa, Arizona 85211-1466 Phone: (480) 644-3258

Prepared for:

DMB Mesa Proving Grounds, LLC

7600 East Doubletree Ranch Road

Suite 300

Scottsdale, Arizona 85258 Phone: (480) 367-7000

Prepared By:

Wood, Patel & Associates, Inc.

2220 South Country Club Drive

Suite 101

Mesa, Arizona 85210 Phone: (480) 834-3300 Fax: (602) 335-8580

Website: www.woodpatel.com

TABLE OF CONTENTS

1.0	INTRO	DUCTION1
	1.1	General Background and Project Location1
	1.2	Scope of the DU 3 South Master Wastewater Report1
	1.3	Wastewater Master Report for Eastmark2
	1.4	Study Area and Development Units2
	1.5	Basis of Design Reports for Specific Individual Developments2
2.0	EXIST	ING CONDITIONS3
	2.1	Topographic Conditions
	2.2	Existing Offsite Wastewater Infrastructure
	2.3	Onsite Wastewater Collection Systems4
3.0	WAST	EWATER SYSTEM DESIGN5
	3.1	Design Criteria5
	3.2	Wastewater Design Flows5
4.0	PROP	OSED SYSTEM7
	4.1	Planned Wastewater Infrastructure
		4.1.1 Ray Sewer Drainage Basin
	4.2	Pipe Sizing7
5.0	CONC	LUSIONS
		TABLES
Table 1		Wastewater Design Criteria
Table 2		Wastewater Design Criteria Eastmark Modeled Land Use DARRELL D.
Table 3		DU-3S Modeled Land Use
Table 4		DU-3S Wastewater Model
Table 5		DU-3S Wastewater Model DU-3S Calculated Pipe Capacities Expira 5 6-30-16
		PLATES

Plate 1 Vicinity Map

Plate 2 DU-3S Master Sewer Exhibit

km Y.\WP\Reports\Residential\113697.08 Eastmark DU-3S Master Wastewater Report docx



1.0 INTRODUCTION

1.1 General Background and Project Location

The proposed Development Unit 3 South (DU-3S) is anticipated to be an approximate 92-acre Development Unit within the 3,155-acre Eastmark master planned community, in Mesa, Arizona. It is a Planned Community District (PCD) which is a mixed-use development that will include single-family residential and open spaces.

This Master Wastewater Report has been prepared in accordance with Wood, Patel & Associates, Inc. (Wood/Patel's) understanding of the City's technical requirements for wastewater collection systems as applicable for Eastmark.

The Site is located within portions of Sections 26 and 27 of Township 1 South, Range 7 East of the Gila and Salt River Meridian. The Site is bounded by the Powerline Floodway and Ray Road alignment to the north, Pacific Proving Grounds on the south and west, and Inspirian Parkway and Eastmark Development Unit 8 (DU-8) to the east (refer to Plate 1 – *Vicinity Map*).

1.2 Scope of the DU 3 South Master Wastewater Report

The DU-3S Master Wastewater Report presents wastewater design flows, and sewer main sizes and locations as required to provide wastewater service to the Site during the full build-out condition. The purpose of this report is to provide a sewer analysis reflecting the developed condition of DU-3S based on a Conceptual Land Use Plan consistent with the *Master Wastewater Report Update for Eastmark*, dated December 17, 2013. While the development of Eastmark will take place over a significant time period, development of DU-3S is anticipated to develop as the next phase. It is the goal of this DU-3S Master Wastewater Report to identify the sewers required to serve the Site, while meeting the requirements of the City's Engineering and Design Standards.

Updates to the DU-3S Master Wastewater Report may be required if significant changes are made to the land uses and assumptions utilized to prepare this report. Additionally, design criteria may change based on actual wastewater generation to calculate demand on the system in the future.

1



1.3 Wastewater Master Report for Eastmark

The *Master Wastewater Report Update for Eastmark*, by Wood, Patel & Associates, Inc. dated December 17, 2013 is being submitted concurrently with this report for review and approval to the City of Mesa. The report sets the design criteria required within Eastmark, and sets sewer basin boundaries tributary to the Elliot Road, Warner Road, and Ray Road offsite sewers. The updated report includes revised land uses and sewer alignments across Eastmark.

1.4 Study Area and Development Units

The study area includes the Ray and Williams Field Sewer Drainage Basins, per the *City of Mesa Wastewater Master Plan Update*, 2009. For a detailed breakdown of modeled land use areas, please refer to the following:

- Table 2 Eastmark Modeled Land Use
- Table 3 *DU-3S Modeled Land Use*
- Table 4 *DU-3S Wastewater Model*
- Plate 2 *DU-3S Master Sewer Exhibit*

1.5 Basis of Design Reports for Specific Individual Developments

As development progresses within the Site, Basis of Design (BOD) reports are required for specific individual developments to ensure compliance with the Master Report and this Development Unit Master Report, and to identify significant variations in land use, wastewater flows, and the wastewater infrastructure needed to serve the parcel.



2.0 EXISTING CONDITIONS

2.1 Topographic Conditions

The Site is located within a portion of Sections 26 and 27 of Township 1 South, Range 7 East, of the Gila and Salt River Meridian. The Site is bounded by the Powerline Floodway and Ray Road alignment to the north, Pacific Proving Grounds on the south and west, and Inspirian Parkway and Eastmark DU-8 to the east. The majority of the Site is surrounded by undeveloped desert and test tracks along the northern, western, and southern boundaries. The Site generally slopes in a southwesterly direction at approximately 0.5 to 1 percent. The peak elevation within the Site, 1419 feet mean sea level (MSL), is located near the intersection of Inspirian Parkway and the Powerline Floodway. The lowest elevation within the Site is approximately 1392 feet MSL, located at the northwest tip of the Site. The Site is covered with typical Sonoran Desert vegetation including mesquite trees, saguaro cactus, creosote, etc.

2.2 Existing Offsite Wastewater Infrastructure

Existing public wastewater infrastructure in the vicinity of the Site includes the following:

- An existing 12-inch gravity sewer located along Mountain Road, between Elliot Road and Pecos Road.
- An existing 12-inch gravity sewer located along Signal Butte Road, between Elliot Road and Galveston Road.
- An existing 18-inch dry gravity sewer located along Warner Road, within the Loop 202 Freeway right-of-way.
- The East Mesa Interceptor (EMI), which is approximately two and one-half (2 ½) miles west of the Site, is an existing 54- and 66-inch gravity sewer line extending in a southerly direction parallel with the East Maricopa Floodway.
- A 27-inch and 30-inch gravity sewer located along Ray Road between Ellsworth Road discharging to East Mesa Interceptor (EMI).
- A 24-inch sewer line in Elliot Road, from Ellsworth Road to just west of Signal Butte Road.



2.3 Onsite Wastewater Collection Systems

Existing public wastewater collection systems onsite include the following:

- An existing 18- and 21-inch gravity sewer along the Ray Road alignment north of the Powerline Floodway.
- A portion of an existing 15-inch sewer within Eastmark Parkway to serve DU-7. DU-7 is currently under construction.



3.0 WASTEWATER SYSTEM DESIGN

3.1 Design Criteria

Wastewater design flows and pipe-sizing criteria utilized in this DU-3S Master Wastewater Report are based on Wood/Patel's understanding of the following:

- The Master Wastewater Report for Eastmark.
- Applicable wastewater system design criteria listed in the 2012 City of Mesa Engineering Design Standards.
- Regionally accepted design standards.
- Title 18, Chapter 9 of the *Arizona Administrative Code*.

Table 1 – Wastewater Design Criteria presents the Unit Daily Wastewater Flow for each land use category based on density and population. This design criterion is used in Table 3 – DU-3S Modeled Land Use to determine the Unit Daily Wastewater Flow for each parcel based on a conceptual land use plan. The wastewater flow criteria are used to estimate the wastewater design flows and determine pipe sizes.

3.2 Wastewater Design Flows

Wastewater design flows for DU-3S are estimated using the design criteria listed above and a conceptual land use plan. Projected full build-out average-day wastewater flows for DU-3S and the existing development within Eastmark including the first phase of the First Solar manufacturing facility and DU-7 are summarized as follows in millions of gallons per day (MGD):

	Offsite Upstream Ray Basin	Offsite Upstream Williams Field Basin	DU-3S	Developed Areas within Eastmark Outside DU-3S	Eastmark	Total
Ray Road Outfall:	1.04 MGD	0.99 MGD	0.10 MGD	0.59 MGD	0.69 MGD	2.72 MGD
Total:	1.04 MGD	0.99 MGD	0.10 MGD	0.59 MGD	0.69 MGD	2.72 MGD

Sewer pipe capacities are based upon conveying the flow at two-thirds of the pipe capacity. It is Wood/Patel's understanding that wet-weather infiltration is accounted for



within the City of Mesa peaking factors listed in the 2012 City of Mesa Engineering Design Standards.

Detailed design flow calculations are provided in Table 4 - DU-3S Wastewater Model, and Table 5 - DU-3S Calculated Pipe Capacities. Wood/Patel utilized criteria within the 2012 City of Mesa Design Standards based on static peaking methodology to calculate peak wet-weather flows for Eastmark. Static methodology is required by the City on an individual project basis to size onsite sewer lines.

It is our understanding the City utilized a diurnal peaking methodology to evaluate the overall tributary area, including Eastmark, to aid in the design of the Ray Road sewer line, from Ellsworth Road to the EMI. Diurnal peaking methodology is based on observed and/or estimated daily wastewater flow cycles for comparable developed areas, and is generally less conservative than static modeling resulting in lower peak flows. As a result, the peak wet-weather flows calculated in this report for Eastmark may vary from those used in designing the Ray Road sewer line. The controlling section of the Ray Road sewer is an offsite 30-inch pipe at 0.2 percent slope. The capacity of this pipe flowing full is 11.94 MGD, and at d/D = 0.9 is 12.7 MGD. Therefore, the peak wetweather flows for Eastmark would not exceed the capacity of the Ray Road sewer.



4.0 PROPOSED SYSTEM

4.1 Planned Wastewater Infrastructure

The City of Mesa's Wastewater Master Plan has four sewer drainage basins within the study area of the Site, which includes the Warner, Ray, Williams Field, and Elliot Sewer Drainage Basins. The Elliot Basin serves the First Solar Manufacturing Facility within DU 6. DU-3S is proposed to contribute wastewater flow to the Ray Sewer Drainage Basin. Currently, the offsite Elliot Road and Ray Road sewers have been constructed downstream of Eastmark, and the Warner Road and Williams Field Road sewers have not been designed or constructed.

4.1.1 Ray Sewer Drainage Basin

The development east of Mountain Road discharges into an existing sewer line along Mountain Road. An existing diversion structure at Mountain Road and Ray Road allows the City to send the flows to either the Ray Road or Pecos Road Sewers. All flow north of Ray Road is currently diverted to the Ray Road Sewer, while flow from development south of Ray Road is conveyed south to Pecos Road. It is the City's intent to continue this mode of operation to provide additional capacity in the Pecos Road Sewer for future development along Pecos Road. This report considers the total design flow from the existing developments east of Eastmark for the Ray Road sewer contributing full build-out flow at this time. This upstream flow is accounted for per the *Master Wastewater Report for Ray Road Sewer between Ellsworth and Mountain Roads*, prepared by CMX, L.L.C., dated November 18, 2005.

4.2 Pipe Sizing

Proposed sewer lines for the Site were sized to accommodate peak wet-weather flow conditions for the full build-out condition. The onsite collection system includes planned sewer mains with diameters ranging from 8 inches to 21 inches. Refer to Tables 4 and 5 for wastewater models and calculated pipe capacities, and Plate 2 for the planned DU-3S wastewater infrastructure. DU-3S is proposed to consist of approximately 4,940 feet of 8-inch gravity sewer line.



5.0 CONCLUSIONS

The Master Wastewater Report for Development Unit 3 South at Eastmark presented herein meets City of Mesa standards and requirements, and serves as a guide for construction documents associated with the planned wastewater system. The following items highlight critical conclusions:

- 1. Development Unit 3 South is anticipated to be 92 acres within the 3,155-acre Eastmark master planned community in the City of Mesa.
- 2. The wastewater system presented is based on the projected full build-out condition of the Site.
- 3. Wastewater design criteria are based on Wood/Patel's understanding of the 2012 City of Mesa Engineering & Design Standards, regionally accepted design standards, the Master Wastewater Report Update for Eastmark, and Title 18, Chapter 9 of the Arizona Administrative Code.
- 4. The approximate average daily flow generated at build-out by the DU-3S is 0.10 MGD per Section 3.2 of this report.
- 5. Proposed onsite sewer mains are sized to accommodate peak wet-weather design flow for the full build-out condition.
- 6. The planned public wastewater collection system will outfall into the existing gravity sewer line located along Ray Road.
- 7. Wood/Patel's model of the proposed wastewater system provides conveyance and capacity in conformance with the City of Mesa's standards and Title 18 of the *Arizona Administrative Code*.



Wastewater Design Criteria

Project: Location: References: DU 3 South at Eastmark

Mesa, Arizona 2012 City of Mesa Engineering Design Standards

TABLE 1 - WASTEWATER DESIGN CRITERIA
CIVIL ENGINEERS * HYDROLOGISTS * LAND SURVEYORS * CONSTRUCTION MANAGERS
Proj. Number: 113697.08
Proj. Engineer: Darrell Smith, P.E.

IT DAILY RESIDENTIA	AL WASTEWATER FLOWS											
			ING UNIT				WASTEWAT FLO	WS	WAST	DAILY EWATER		
			ISITY	POPULATIO		PERSONS	(PER C			ows		
IND USE CATEGORY	LAND USE	VALUE	UNITS	VALUE	UNITS	PER ACRE	Value	Units	Value	Units	NOTES	
LDR-1	Low Density Residential	0.5			Persons/	٠		GPD/	400	GPD/AC		
LUK-1	(LDR 0-1)	0.5	DU / Acre	2.5	DU Persons/	1.25	80	Person GPD/	100		1	
LDR-2	LDR 0-1 & LDR 1-2 AVG.	1	DU / Acre	2.5	DU	2.50	80	Person	200	GPD/AC		
	Low Density Residential		2077.00	2.0	Persons/	2.00	1	GPD/		CDD/AA	1	
LDR-3	(LDR-1-2)	1.2	DU / Acre	3.0	DU	3.60	80	Person	288	GPD/AC		
	Medium Density Residential				Persons/			GPD/		GPD/AC	Source: Dwelling ur	
MDR-1	(MDR 2-4)	3.0	DU / Acre	3.0	DU	9.00	80	Person	720	Q. D. 10	density divisions are	
MDR-2	MDR 2-4 & MDR 4-6 AVG.	4	D		Persons/ DU	40.50		GPD/	1.000	GPD/AC	based on City of Me 2025 General Plan.	
MDR-2	Medium Density Residential	4	DU / Acre	3.1	Persons/	12.50	80	Person GPD/	1,000		wastewater flows ar	
MDR-3	(MDR 4-6)	5,0	DU / Acre	3.2	DU	16.00	80	Person	1,280	GPD/AC	based on the City of	
100110	Medium Density Residential	<u> </u>		0.2	Persons/	10.00	1	GPD/	1,200		Mesa 2012 Enginee	
MDR-4	(MDR 6-10)	6.5	DU / Acre	2.7	DU	17.55	80	Person	1,404	GPD/AC	and Design Standar	
	High Density Residential		1		Persons/			GPD/		GPD/AC	1	
HDR-1	(HDR 10-15)	11.0	DU / Acre	2.0	DU	22.00	80	Person	1,760	GFD/AC	1	
	High Density Residential			1	Persons/	l		GPD/		GPD/AC		
HDR-2	(HDR 15+)	17.0	DU / Acre	1.7	DU	28.90	80	Person	2,312	41 ,2 4	4	
MUR-1	Mixed Use/Residential (MUR) Residential	15.0	DU / Acre	1.7	Persons/ DU	25.50	80	GPD/	2,040	GPD/AC		
			DU/AG6	1,7	UO UO	25.50	αU	Person	2,040			
P DAILY NON-RESID	ENTIAL WASTEWATER FLOW	5										
						WASTEWAT	ER DESIGN	UNIT D	AILY			
						FLO		WASTEV				
Į.	DWELLING UNIT DEN	SITY	POPULATI	ON DENSITY	PERSONS	(PER C	APITA)	FLÖ	WS			
LAND USE	VALUE	UNITS	VALUE	UNITS	PER ACRE	Value	Units	Value	Units	NOTES		
	_			_		_	_	150	GPD/			
Hotel				-				100	ROOM	Source: City of Mesa 2007		
Commercial/Retail Office	_	_	23.0	Employees/	23.00	54	GPD/ Employee	1,242	GPD/			
Education/Civic/				Acre Employees/	23.00	24	GPD/	1,242	AC GPD/	i miĝirio en ili	ring and Design Standards.	
Church	-	_	15.0	Acre	15.00	54	Employee	810	AC	1		
FSITE			1,1,1			•		0.10	110			
	•••					WASTEWAT	ED DEGICN	UNIT D	AH V			
						FLO		WASTEV				
	DWELLING UNIT DEN	SITY	POPULATI	ON DENSITY	PERSONS	(PER C		FLO		llores.		
LAND USE	VALUE	UNITS	VALUE	UNITS	PER ACRE	Value	Units	Value	Units	1	NOTES	
		1		Employees/			GPD/		GPD/			
cc	_ -		14.0	Acre	14.00	54	Employee	756	AC	1		
	_	_	20.0	Employees/	an		GPD/		GPD/			
0			23.0	Acre Employees/	23.00	54	Employee GPD/	1,242	AC GPD/	1		
RC	-	-	14.0	Acre	14.00	54	Employee	756	AC AC			
			14,0	Employees/	14.00	-	GPD/	7.00	GPD/	Source: C	ity of Mesa 2007	
BPI	<u>-</u>	_	8.0	Acre	8.00	54	Employee :	432	AC			
	_			Employees/			GPD/		GPD/	Engineering and Design Standards and the City of Mesa 2025 General		
NC .	_		11.0	Acre	11.00	54	Employee	594	AC	Plan		
1	-	-		Employees/			_ GPD/		GPD/			
LI			7.0	Acre	7.00	54	Employee	378	AC CPP/	4		
MUE	_	-	15.0	Employees/	15.QD	54	GPD/	810	GPD/			
MUE			15.0	Acre Employees/	10.00	D4	Employee GPD/	610	AC GPD/	1		
GI	-	-	15.0	Acre	15.00	54	Employee	810	AC			
										L		
									GPD/	for Ray Ro	aster Wastewater Re ad Sewer Between and Mountain Roads	

Description	Value	Units	Note(s)
General			Ή
Minimum Velocity (d/D=2/3)	2	ft/sec	1
Maximum Flow Velocity (d/D=2/3)	9	ft/sec	1
Maximum Peak Flow Depth-to-Diameter Ratio (d/0)	0.67	-	
Minimum Pipe Diameter	8	in	1
Manning's "n" value	0.013	-	2
Peaking Factor (ADF< 1.0 MGD)	3		1
Peaking Factor (1.0 < ADF< 10.0 MGD)	2.5		1
Peaking Factor (10.0 < ADF< 20.0 MGD)	2.3		1

Notes: 1. Per The City of Mese 2012 Engineering & Design Standards 2. Title 18, Chapter 9 of the Arizona Administrative Code

Eastmark Modeled Land Use

Proj. Number: 113697.08 Proj. Engineer: Darrell Smith, P.E.

DU 3 South at Eastmark Mesa, Arizona Project: Location:

	ltiai ow		
	Total Residential Units/Flow		2,490
	Mixed Use Residential Units	0.0	0
	Residential Total	597.0	2,490
	HDR-2	0.0	0
NMO	HDR-1	20.0	220
ENTIAL LAND USE AND DWELLING UNIT BREAKDOWN	MDR-4	0.0	0
SE AND DA	MDR-3	8'906	1,342
AL LAND U	MDR-2	6.26	391
Y RESIDENT	MDR-1	177.8	537
K - PRELIMINAR	LDR-2	0.0	0
EASTMARK - P	Land Use	Acreage	Dwelling Units

	_			_						

					Total Floor	-	-	-	Gross	Gross
Ē	0		Civic	Civic	Education Church Civic	Area Education Church Civic	1)(3) Area Education Church Civic	1)(3) Area Education Church Civic	Dwelling Non-Residential (1/3) Area Education Church Civic	Non-Residential ⁽¹⁾⁽³⁾ Area Education Church Civic
	(AC)		(AC)	(AC)	(AC) (AC)	(AC) (AC)	(sq. ft.) (AC) (AC)	(AC) (Sq. ft.) (AC) (AC)	Keys (AC) (Sq.ft.) (AC) (AC)	Units Keys (AC) (sq.ft.) (AC) (AC)
	0.0	0.0 0.0	_	0.0	0.0	0.0	0.0	0.0	0.0 0.0 0.0 0.0 0.0 0.0	391 0 0.0 0.0 0.0 0.0 0.0 0.0
0.0	0.0		0.0	0.0 0.0	0.0 0.0 0.0	0.0 0.0 0.0	1,324,601 0.0 0.0 0.0 0.0	1,324,601 0.0 0.0 0.0 0.0	0 0 0 00 00 00 00 00 00	0 0 0 00 00 00 00 00 00
		35.3	2.5 35.3	13.5 2.5 35.3	20.0 13.5 2.5 35.3	20.0 13.5 2.5 35.3	200 135 2.5 353	200 135 2.5 353	0 55 15,000 200 135 25 353	2129 0 5.5 15,000 200 13.5 2.5 35.3
<u> </u>	35.3	+	2.5	12.6	200 148 25	155,000 200 128 25	155,000 200 128 25	0.0 5.5 45.000 20.0 13.8 2.5	2129 () 5.6 45.00 20.0 12.6 25.	5047 2 2 0 5.5 1525,001 20,0 0.0 0.0 0.0 0.0
	Other (AC)		Civic (AC) 0.0	Church Civic (AC) (AC) (AC) 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.	Education Church Civic (AC) (AC) (AC) (AC) (AC) 2.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0	Total Floor Education Church Civic (Sq. ft.) (AC) (AC) (AC) (AC) (AC) (AC) (AC) (AC	Onn-Residential (**)	Non-Residential ⁽¹⁾⁽³⁾	Total Gross Total Floor Church Civic Church Civic Church Civic Church Civic Church Civic Church Civic Church Church Civic Church Church Civic Church Church Church Civic Church Church	Total Gross Total Floor Church Civic Church Civic Church Civic Church Civic Church Civic Church Civic Church Church Civic Church Church Civic Church Church Church Civic Church Church

(1) Non-residential wastewater flows are calculated based on net non-residentiat acreage.

(2) See Table 2 - Wastewater Design Criteria for additional design criteria information. UNIT DAILY RESIDENTIAL WASTEWATER FLOWS $^{\mathrm{Pl}}$

from non-residential acreage of approximately 50.7 acres for the First Solar phase 1 (1 FAB) were taken from the Beck Consulting Final Sewer rige to the offsite Elliot Road Sewer, and approximately 15 acres of First Solar phase 1 administrative buildings which discharge to the offsite awer.

	GPD/AC	810	Education/Civic/ Church
	GPD/AC	1,242	Commercial / Retail / Office (Not Area)
	GPD/ROOM	150	Hotel
	Units	Value	LAND USE
	UNIT DAILY WASTEWATER	INO TINO	
	WATER FLOWS ⁽²⁾	NTIAL WASTE	UNIT DAILY NON-RESIDENTIAL WASTEWATER FLOWS ⁽²⁾
	GPD/AC	2,040	MUR-1
	OP/Q45	2,312	HDR-2
GPD/AC = Gallons Per Day Per Acre	GPD/AC	1,760	HDR-1
GPD = Gallons Per Day	GPD/AC	1,404	MDR-4
AC = Acres	GPD/AC	1,280	MDR-3
Abbreviations:	GPD/AC	000'1	MDR-2
	GPD/AC	720	MDR-1
	GPD/AC	288	LDR-3
	GPD/AC	200	LDR-2
	GPD/AC	100	LDR-1
	Units	Value	LAND USE CATEGORY
(3) Contributing flows from non-residential Report which discharge to the offsite Ellit Signal Butte Road sewer.	UNIT DAILY WASTEWATER FLOWS	UNIT DAI	

DU-3S Modeled Land Use

Proj. Number: 113697.08 Proj. Engineer: Darrell Smith, P.E.

DU-3S at Eastmark Mesa, Arizona Project: Location:

	896'96	96,968		1212			0.0		92.3	391	DU-3S Totals
_	33,976	33,976	80	424.7	3.1	MDR-2		4.43	30.9	137	DU-3I
	62,992	62,992	80	787.4	3.1	MDR-2	-	4.14	61.4	254	DU-3H
	Total Avg Day	Avg Day	GPDC	Total Population	Population Density (persons/ DU or Acre)	Land Use	Non-Residential Acres	Density (DU/AC)	Residential Acres	No. of DUs	DU Sub-Area
							BREAKDOWN		AND DWELLIN	RELIMINARY LAND USE AND DWELLING UNI	PRELIMINAR

DU-3S Wastewater Model

CIVIL ENGINEERS * HYDROLOGISTS * LAND SURVEYORS * CONSTRUCTION MANAGERS

Project; Location: References: DU 3 South at Eastmark

Mesa, Arizona

City of Mesa 2012 Engineering and Design Standards Arizona Administrative Code, Title 18, Chapter 9 Proj. Number: 113697.08 Proj. Engineer: Darrell Smith, P.E.

FROM NODE	TO NODE	SEWER AREA(S) SERVED	AREA SERVED (ACRES)	UNIT FLOW (GPD/AC)	PARCEL ADF (GPD)	SEWER NODE ADF (GPD)	TOTAL ADF (GPD)	PEAKING FACTOR	PEAK WET WEATHER FLOW (GPD)
Elliot Road Onsi	to Wastewater Flo	ws							
		FIRST SOLAR PHASE 1	50.7	12,951	656,640	656,640	656,640	3.0	1,969,920
Ray Road Onsiti	e And Offsite Upstr	ream Wastewater Flo	WS						
R21	R19	1/3 DU-7A	48.3	-	50,580	50,580	50,580	3.0	151,740
R24	R19	2/3 DU-7A	96.7	ı	101,159	101,159	101,159	3.0	303,477
R19	R22	-		1	_	-	151,739	3.0	455,217
R22	R23	1/2 DU-7B	52.2		67,584	95,714	247,453	3.0	742,359
1422	1023	1/2 DU-7C	31.8	-	28,130	30,,14	247,400	J 0.0	142,000
R23	R26	1/2 DU-7B	52.2	-	67,584	95,714	343,167	3.0	1,029,501
1420	1/20	1/2 DU-7C	31.83		28,130	85,114	545,101	0.0	1,020,001
R26	R27	DU-7E	55.0	_	62,720	71,576	414,743	3.0	1,244,229
1\20	N21	DU-7F	25.7	-	8,856	71,510	414,140	3.0	1,244,225
		OFFUPSTREAM(1)	1,473	707	1,041,710				
R41	R40	FIRST SOLAR PHASE 1 ADMIN	15	3,200	48,002	1,203,232	1,203,232	2.5	3,008,080
		DU-70	157.8	ı	113,520				
R40	R27	DU-7G	20.0	-	15,360	15,360	1,218,592	2.5	3,046,480
R27	R12	-	**	I	-	_	1,633,335	2.5	4,083,338
R12	R11	-	1	-	-	-	1,633,335	2.5	4,083,338
R11	R2	**	1	ы	••	1	1,633,335	2.5	4,083,338
R39	R38	DU-3H	61.4	-	62,992	62,992	62,992	3.0	188,976
R38	R2	DU-3I	30.9	-	33,976	33,976	96,968	3.0	290,904
R2	R1A	_	-	-	_	_	1,730,303	2.5	4,325,758
		LDR3-1	316	720	227,520				
	i	BPI-1	160	432	69,120]			
		Gl-1	40	810	32,400	1			
		LI-1	318	378	120,204				
R1A	R1	MUE-1	112	810	90,720	988,206	2,718,509	2.5	6,796,273
1		MŲE-2	7	810	5,670]		1	
l		MDR3-1	231	1,260	295,680]		1	
l		MUR1-1	62	2,040	126,480	j l			
		CC-1	27	756	20,412				
R1	RAY ROAD SEWER	-	1	_	_	-	2,718,509	2.5	6,796,273

Total Onsite Flow to Ray Road Outfall at Ellsworth Road	678.8	688,593	688,593	688,593	1,721,483
Total Onsite Flow, Ray Road + Elliot Road Basins:	729,5	1,345,233	1,345,233	1,345,233	3,691,403
Total to Ray Road Outfall at Ellsworth Road	3424.8	2,718,509	2,718,509	2,718,509	6,796,273

⁽¹⁾ Offsite wastewater flow within the Signal Butte Road sewer line includes flow from the Mountain Horizons and Nova Vista developments (Avg Day = 1,040,576 gpd) per the Master Wastewater Report for Ray Road Sewer Between Ellsworth and Mountain Roads, by CMX, 11/18/2005, and the City of Mesa Signal Butte/Elliot Water Campus (Avg Day = 1,134 gpd)

DU-3S Calculated Pipe Capacities

TABLE 4 - CALCULATED PIPE CAPACITIES, FULL BUILD OUT CONDITION

CIVIL ENGINEERS * HYDROLOGISTS * ŁAND SURVEYORS * CONSTRUCTION MANAGERS
Proj. Number: 113897.08
Proj. Engineer: Darriell Smith, P.E.

Project: DU 3 South at Eastmark
Location: Mesa, Arizona
References: ADEQ Bulletin No. 11
City of Mesa 2012 Engineering and Design Standards

							PEA	K FLOW RES	ULTS	
FROM NODE	TO NODE	NOTES	PIPE DIA. (INCHES)	MODELED PIPE SLOPE (FT / FT)	PIPE CAPACITY (GPD)	PEAK WET WEATHER FLOW (GPD)	d/D (WET WEATHER)	FLOW VELOCITY (FT/S) AT d/D=2/3	SURPLUS CAPACITY (WET WEATHER) (GPD)	PERCENT OF CAPACITY (WET WEATHER)
Ray Road Ba	sin Pipe Sizes									
R21	R19		7	0.0045	362,666	151,740	0.45	2.3	210,926	41.8%
R24	R19		8	0.0050	564,029	303,477	0.53	2.8	260.552	53.8%
R19	R22		12	0.0045	1.522.778	455,217	0.38	3.3	1,067,561	29.9%
R22	R23		15	0.0020	1.903.379	742.359	0.43	2.7	1,161,020	39.0%
R23	R26		15	0.0020	1.903.379	1,029,501	0.53	2.7	873.878	54.1%
R26	R27		15	0.0020	1,903,379	1,244,229	0,58	2.7	659,150	65,4%
R41	R40		18	0.0064	5,481,895	3,008,080	0.53	5.3	2,473,815	54.9%
R40	R27		18	0.0070	5,710,307	3.046.480	0.52	5.5	2,663,827	53.4%
R27	R12		21	0.0032	5,751,516	4,083,338	0.62	4.1	1,668,178	71.0%
R12	R11		21	0.0030	5,596,069	4.083,338	0.63	4.0	1,512,731	73.0%
R11	R2		21	0.0038	6,373,301	4.083.338	0,58	4.5	2,289,963	64.1%
R39	R38		8	0.0049	541,468	188,976	0.41	2.7	352,492	34.9%
R38	R2		8	0.0050	564,029	290,904	0.51	2.8	273,125	51.6%
R2	R1A		21	0.0045	6,839,640	4.325,758	0.58	4.9	2,513,882	63.2%
R1A	R1	PER PLAN	24	0.0081	13,197,121	6,796,273	0.51	7.2	6,400,848	51.5%

R1A NOTES:

PLATE 1

Vicinity Map


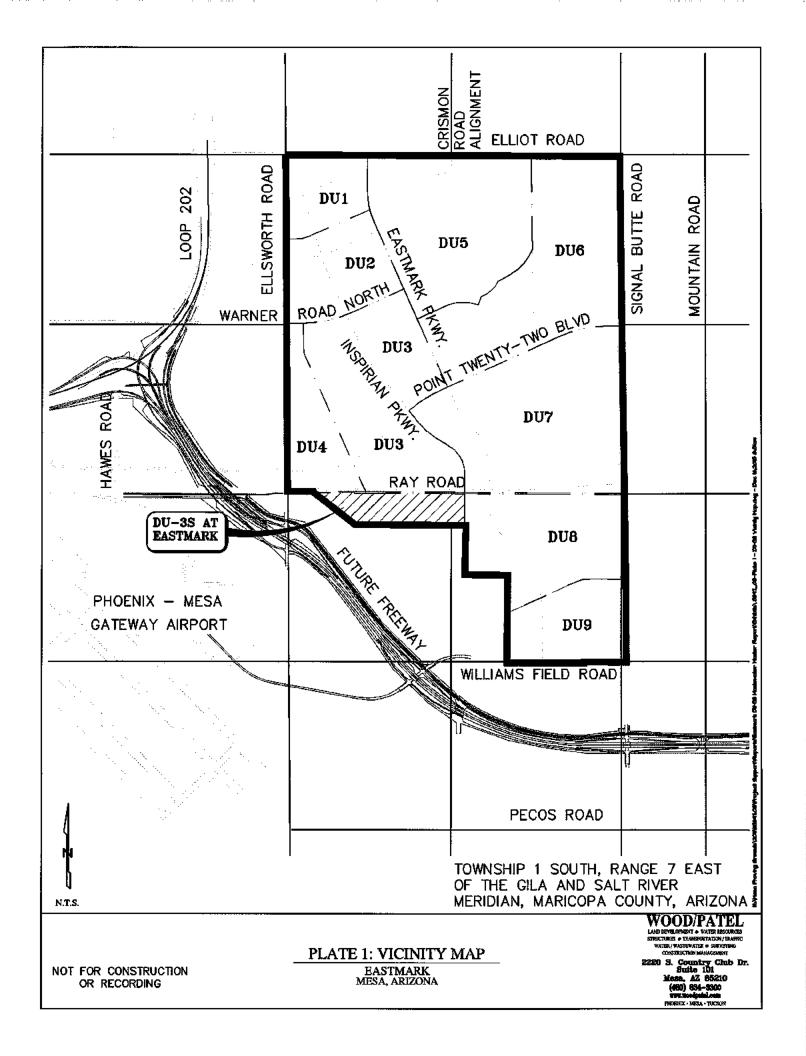


PLATE 2

DU-3S Master Sewer Exhibit

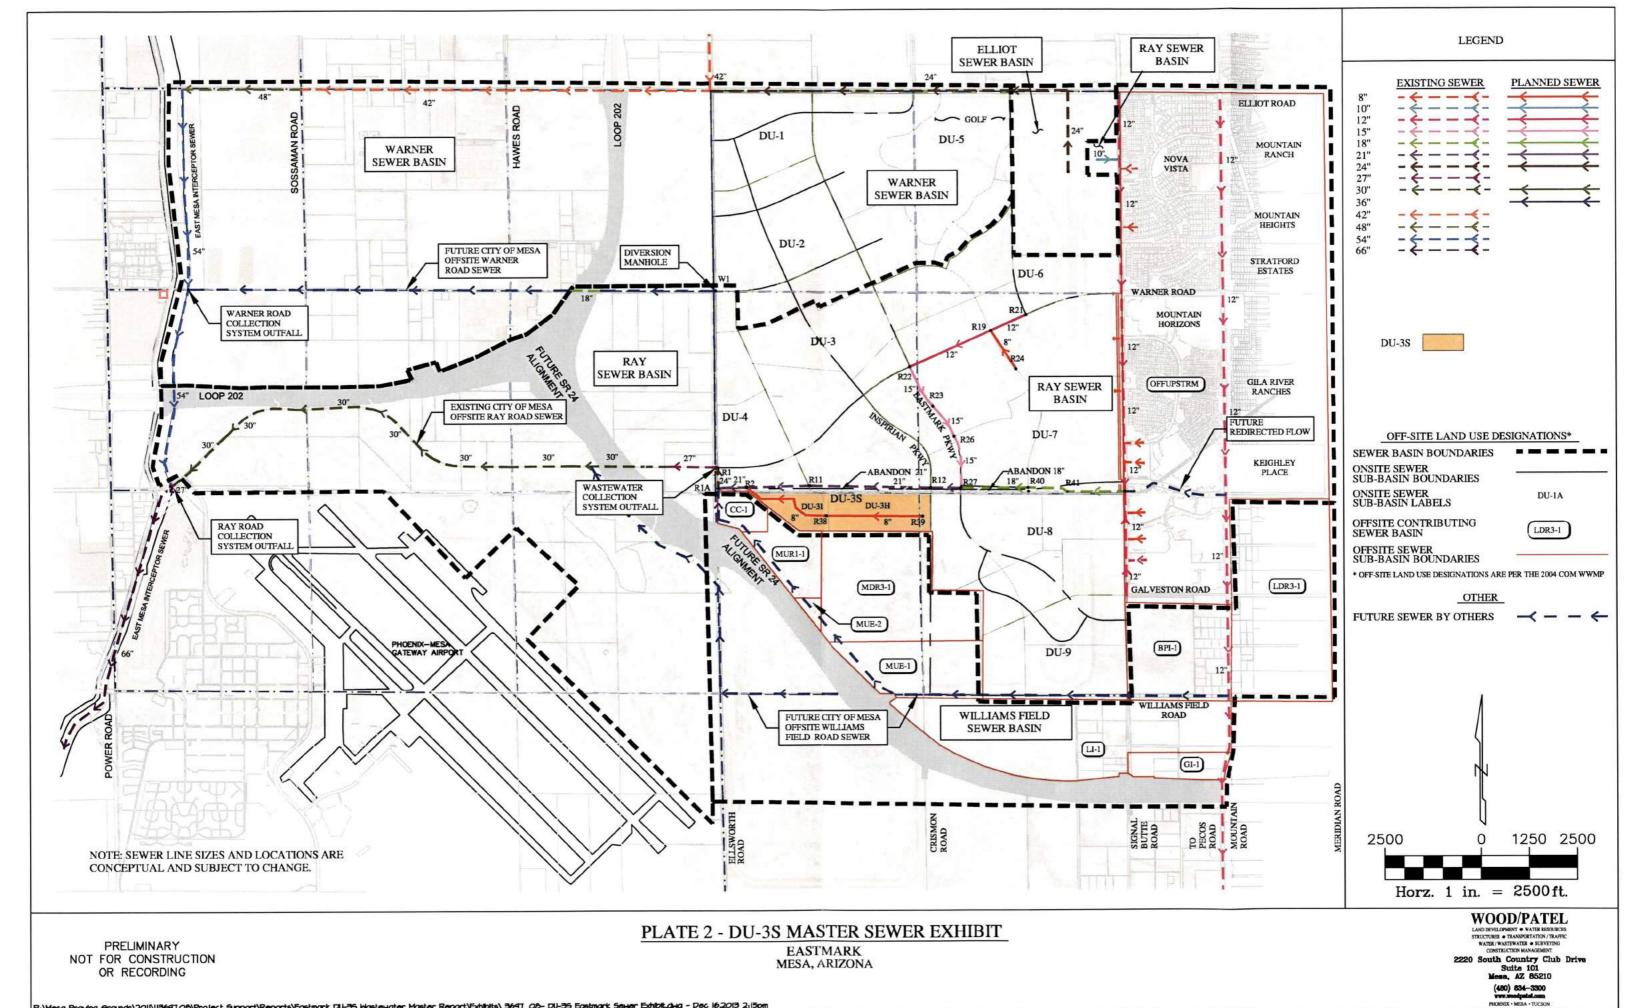

R.\Mesa Proving Grounds\201N15647.06\Project Support\Reports\Eastmark DU-35 Wasterlater Master Report\Exhibits\ 3647_08- DU-35 Eastmark Sewer Exhibit.dwg - Dec 16,2013 2:15pm